

Recorded: 6/21/2024 at 2:19:06.0 PM
County Recording Fee: \$0.00
Iowa E-Filing Fee: \$0.00
Combined Fee: \$0.00
Revenue Tax: \$0.00
Delaware County, Iowa
Daneen Schindler RECORDER
BK: 2024 PG: 1385

REAL ESTATE TRANSFER - GROUNDWATER HAZARD STATEMENT
TO BE COMPLETED IN FULL BY TRANSFEROR

If the transaction is exempt from filing a declaration of value pursuant to Iowa Code 428A.1(2), **STOP HERE**. Pursuant to Iowa Code section 558.69(1), when no declaration of value is submitted during a transaction, you are not required to submit a groundwater hazard statement or include the statutory language in Iowa Code section 558.69(8A). Please consult your realtor or legal counsel for further advice, including on whether a declaration of value is required. The Department provides this information for statutory reference only.

Instructions for this document can be found at:
<https://www.iowadnr.gov/Portals/idnr/uploads/forms/5420960%20Instructions.pdf>

Attachment 1, if required, can be found at: <https://www.iowadnr.gov/Portals/idnr/uploads/forms/5420960a.pdf>

TRANSFEROR:

Name Luke W. Livingston and Jennifer D. Livingston
Address 24622 198th Avenue Manchester IA 52057
Number and Street or RR City, Town or PO State Zip

TRANSFeree:

Name Michael Lee Oltmanns and Julia Kirsten Oltmanns
Address 30392 Olde Hawkeye Road Dyersville IA 52040
Number and Street or RR City, Town or PO State Zip

Address of Property Transferred:
24622 198th Avenue Manchester IA 52057
Number and Street or RR City, Town or PO State Zip

Legal Description of Property: (Attach if necessary)

See attached Exhibit A

1. Wells (check one) ~

- No Condition - There are no known wells situated on this property.
- Condition Present - There is a well or wells situated on this property. The type(s), location(s) and legal status are stated below or set forth on an attached separate sheet, as necessary.

2. Solid Waste Disposal (check one)

- No Condition - There is no known solid waste disposal site on this property.
- Condition Present - There is a solid waste disposal site on this property and information related thereto is provided in Attachment #1, attached to this document.

3. Hazardous Wastes (check one)

- No Condition - There is no known hazardous waste on this property.
- Condition Present - There is hazardous waste on this property and information related thereto is provided in Attachment #1, attached to this document.

4. Underground Storage Tanks (check one)

- No Condition - There are no known underground storage tanks on this property. (Note exclusions such as small farm and residential motor fuel tanks, most heating oil tanks, cisterns and septic tanks, in instructions.)
- Condition Present - There is an underground storage tank on this property. The type(s), size(s) and any known substance(s) contained are listed below or on an attached separate sheet, as necessary.

5. Private Burial Site (check one)

- No Condition - There are no known private burial sites on this property.
- Condition Present - There is a private burial site on this property. The location(s) of the site(s) and known identifying information of the decedent(s) is stated below or on an attached separate sheet, as necessary.

6. Private Sewage Disposal System (check one)

- No Condition - All buildings on this property are served by a public or semi-public sewage disposal system.
- No Condition - This transaction does not involve the transfer of any building which has or is required by law to have a sewage disposal system.
- Condition Present - There is a building served by private sewage disposal system on this property or a building without any lawful sewage disposal system. A certified inspector's report is attached which documents the condition of the private sewage disposal system and whether any modifications are required to conform to standards adopted by the Department of Natural Resources. A certified inspection report must be accompanied by this form when recording.
- Condition Present - There is a building served by private sewage disposal system on this property. Weather or other temporary physical conditions prevent the certified inspection of the private sewage disposal system from being conducted. The buyer has executed a binding acknowledgment with the county board of health to conduct a certified inspection of the private sewage disposal system at the earliest practicable time and to be responsible for any required modifications to the private sewage disposal system as identified by the certified inspection. A copy of the binding acknowledgment is attached to this form.
- Condition Present - There is a building served by private sewage disposal system on this property. The system is failing to ensure effective wastewater treatment or is otherwise improperly functioning, and the buyer has executed a binding acknowledgment with the county board of health to install a new private sewage disposal system on this property within an agreed upon time period. A copy of the binding acknowledgment is provided with this form.
- Condition Present - There is a building served by private sewage disposal system on this property. The building to which the sewage disposal system is connected will be demolished without being occupied. The buyer has executed a binding acknowledgment with the county board of health to demolish the building within an agreed upon time period. A copy of the binding acknowledgment is provided with this form. [Exemption #7]
- Condition Present - There is a building served by private sewage disposal system on this property. This property is exempt from the private sewage disposal inspection requirements pursuant to the following Exemption [Note: for exemption #7 use prior check box]: _____
- Condition Present - There is a building served by private sewage disposal system on this property. The private sewage disposal system has been installed within the past two years pursuant to permit number: _____

Review the following two directions carefully:

- A. If you selected a box stating "No Condition" for every numbered section above, STOP HERE. Do not submit this form. Instead, pursuant to Iowa Code section 558.69(8A), you must include the following language on the first page of the recorded deed, instrument, or other writing:

"There is no known private burial site, well, solid waste disposal site, underground storage tank, hazardous waste, or private sewage disposal system on the property as described in Iowa Code section 558.69, and therefore the transaction is exempt from the requirement to submit a groundwater hazard statement."

Please consult your realtor or legal counsel for further advice on this exemption. By law, the owner of the property is responsible for the accuracy of this statement, and the Department provides this information for statutory reference only.

- B. If you checked any box stating "Condition Present" for any of the numbered sections above, continue below. You must complete this form, including providing all required information, and you must submit this form to the county recorder's office with declaration of value.

Information required by statements checked above should be provided here or on separate sheets attached hereto:

I HEREBY DECLARE THAT I HAVE REVIEWED THE INSTRUCTIONS FOR THIS FORM AND THAT THE INFORMATION STATED ABOVE IS TRUE AND CORRECT.

Signature: *Laura Huntington*
(Transferor or Agent)

Telephone No.: 563-929-6740



TIME OF TRANSFER INSPECTION TOT# 10427 BILL DOWNS CERT # 8880

Site Information

Parcel Description: **Jennifer Livingston**

Address: **24622 198th Ave, Manchester, IA 52057** County: **Delaware**

Owner Information

Property is owned by a business: **No**

Business Name:

Owner Name: **Jennifer Livingston**

Email Address:

Address: **24622 198th Ave, Manchester, IA 52057**

Phone No: **319-431-3886**

Additional Contact Information

Name	Email Address	Affiliate Type
Teresa Turnis	teresaturnis@gmail.com	Realtor

Site related information

No Of Bedrooms: 3	Inspection Date: 06/01/2024
Facility Type: Residential	Currently Occupied: Yes
Last Occupied:	System Installation Date: 06/19/1996
Permit issued by County: Yes	Permit Number:
All plumbing fixtures enter septic system: Yes	County contacted for records: Yes
Property Information Comments:	

Primary Treatment

Tank 1

Tank Name: Tank 1	Type: Septic Tank	Tank Size (Gal): 1000
Tank Material: Concrete	Tank Corrosion Type: Slight	Liquid Level Type: Normal
No. of Compartments: 2	Pump Tank Chamber: Yes	Licensed Pumper Name: Bill Downs

Date Pumped: **6/1/2024** Meets Setback to Well: **Yes** Well Type: **Private**
Distance To Well (Ft.): **100+** Is Accessible: **Yes** Lid Intact: **Yes**
Risers Intact: **Yes** Effluent Filter Present: **No** Watertight: **Yes**
Tank/Vault Pumped: **Yes** Inlet Baffle Present: **Yes** Outlet Baffle Present: **Yes** Functioning as Designed: **Yes**
Tank Comments:

General Primary Treatment Comments:

Distribution Type

Distribution Box 1

Label: **Distribution Box 1** Material Type: **Concrete** Accessible: **Yes**
Box Opened: **Yes** Baffle Present: **Yes** Speed Levelers Present: **No**
Watertight: **Yes** Functioning As Designed: **Yes**

General Distribution System Comments : **One line was running slow, 2 lines took water ok. Had 8" of rain the week before so the ground is saturated. Ran water 40 minutes no back up, working ok at time of inspection**

Secondary Treatment

Lateral Field1

Distribution Type: **Distribution Box** Material Type: **Rock and PVC Pipe** Trench Width: **unknown**
Lines: **3** Total Length of Absorption Line: **200 / permit** System Hydraulic Loaded: **Yes**
Gallons Loaded: **400** Meets Setback to Well: **Yes** Well Type: **Private**
Distance To Well (Ft.): **100+** Lateral Lines Probed: **Yes** Saturation or Ponding Present: **No**
Grass Cover Present: **Yes** Lateral Lines Equal Length: **No** System Located on Owner Property: **Yes**
Easement Present: **N/A** Functioning as Designed: **Yes**
Comments:

General Secondary Treatment Comments:

Narrative Report

TOT Inspection Report Overall Narrative Comments: **System working ok at time of inspection.**



TIME OF TRANSFER INSPECTION TOT# 10427 BILL DOWNS CERT # 8880

Owner Name: **Jennifer Livingston**

Address: **24622 198th Ave , Manchester , IA 52057**

County: **Delaware**

Inspection Date: **06/01/2024**

Submitted Date: **6/5/2024**

DELAWARE COUNTY BOARD OF SUPERVISORS 246 22-198^A (Print or Type) Permit No. 489

APPLICATION FOR PERMIT TO INSTALL PRIVATE SEWAGE DISPOSAL SYSTEM


ADDRESS: RR #1, Manchester Section 15 Township M.L.O
LOCATION: SE 1/4 SE 1/4 TRIN R5W
Owner: Scott Landegren Plumber: FIN Construction
Lot Size: 15 x 282 Type Commercial: _____ Residential: (No. Bedrooms) 3
Fixtures: Sinks Lavatories Bath Tubs Showers Sinks Automatic Laundry _____ Sump Pump _____
Septic Tank made by CASCADE Garbage Grinder _____ Construction Material CONCRETE Gallons Cap 1000

Percolation Test: 1 _____ 2 _____ 3 _____ 4 _____ Made by: _____
Absorption Field: Total length of laterals 200 No. of lateral lines 3
#10"

This system is new Existing _____

I certify that the above information is correct and that all proposed work will be completed in accordance with the Delaware County Regulations.

Date Approved 6/19/96
By Jack Norton INSPECTOR
APPLICANT'S SIGNATURE Scott Landegren
SEAL

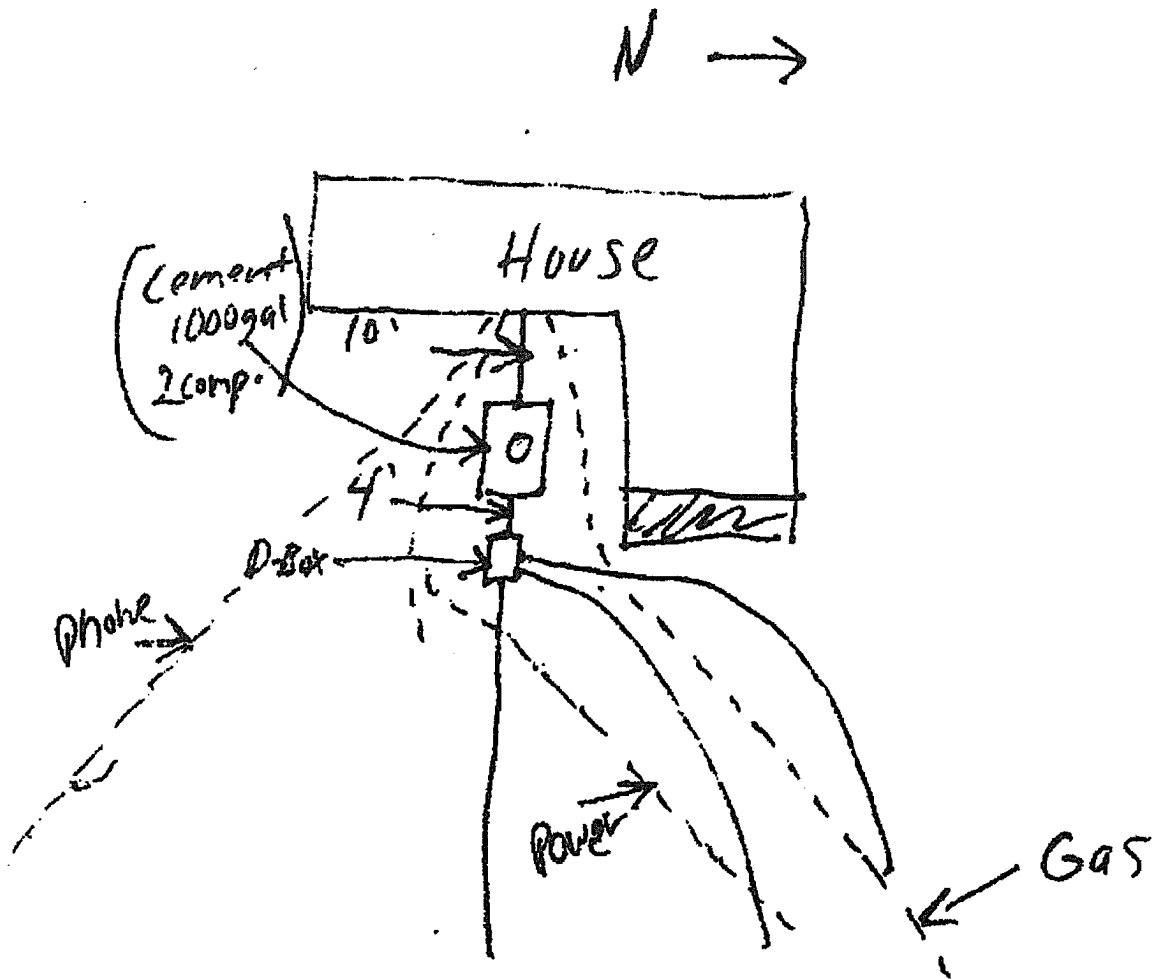

Tank and D-box was uncovered. Baffles in tank and D-box appears to be in good condition. Hydraulically tested by running water for 40 minutes. There was no rise in the effluent level. Indicating the fields were accepting the water. All fixtures went to Septic. This system was properly functioning the day of the inspection.