

BK: 2025 PG: 2116
Recorded: 8/11/2025 at 12:27:14.0 PM
Pages 23
County Recording Fee: \$0.00
Iowa E-Filing Fee: \$0.00
Combined Fee: \$0.00
Revenue Tax: \$0.00
BRANDY L. MACUMBER, RECORDER
Madison County, Iowa

**REAL ESTATE TRANSFER - GROUNDWATER HAZARD STATEMENT
TO BE COMPLETED BY TRANSFEROR**

If the transaction is exempt from filing a declaration of value pursuant to Iowa Code 428A.1(2), **STOP HERE**. Pursuant to Iowa Code section 558.69(1), when no declaration of value is submitted during a transaction, you are not required to submit a groundwater hazard statement or include the statutory language in Iowa Code section 558.69(8A). Please consult your realtor or legal counsel for further advice, including on whether a declaration of value is required. The Department provides this information for statutory reference only.

Instructions for this document can be found at:

<https://www.iowadnr.gov/Portals/Idnr/uploads/forms/5420960%20Instructions.pdf>

Attachment 1, if required, can be found at: <https://www.iowadnr.gov/Portals/Idnr/uploads/forms/5420960a.pdf>

TRANSFEROR:

Name: Timothy L. Kadlec

Address: 1720 Merriam Ct, Winterset, IA 50273

TRANSFeree:

Name: Matthew W. Holeten

Address: 1720 Merriam Ct, Winterset, IA 50273

Address of Property Transferred:

1720 Merriam Ct, Winterset, Iowa 50273

Legal Description of Property: (Attach if necessary)

Lots Three (3), Four (4), and Five (5), of Hillcrest Subdivision, located in the East Half (1/2) of the Northeast Quarter (1/4) of Section Ten (10), Township Seventy-six (76) North, Range Twenty-seven (27) West of the 5th P.M., Madison County, Iowa.

1. Wells (check one)

- ☒ No Condition - There are no known wells situated on this property.
- ☐ Condition Present - There is a well or wells situated on this property. The type(s), location(s) and legal status are stated below or set forth on an attached separate sheet, as necessary.

2. Solid Waste Disposal (check one)

- ☒ No Condition - There is no known solid waste disposal site on this property.
- ☐ Condition Present - There is a solid waste disposal site on this property and information related thereto is provided in Attachment #1, attached to this document.

3. Hazardous Wastes (check one)

- ☒ No Condition - There is no known hazardous waste on this property.

- ☐ Condition Present - There is hazardous waste on this property and information related thereto is provided in Attachment #1, attached to this document.

4. Underground Storage Tanks (check one)

- ☒ No Condition - There are no known underground storage tanks on this property. (Note exclusions such as small farm and residential motor fuel tanks, most heating oil tanks, cisterns and septic tanks, in instructions.)
- ☐ Condition Present - There is an underground storage tank on this property. The type(s), size(s) and any known substance(s) contained are listed below or on an attached separate sheet, as necessary.

5. Private Burial Site (check one)

- ☒ No Condition - There are no known private burial sites on this property.
- ☐ Condition Present - There is a private burial site on this property. The location(s) of the site(s) and known identifying information of the decedent(s) is stated below or on an attached separate sheet, as necessary.

6. Private Sewage Disposal System (check one)

- ☐ No Condition - All buildings on this property are served by a public or semi-public sewage disposal system.
- ☐ No Condition - This transaction does not involve the transfer of any building which has or is required by law to have a sewage disposal system.
- ☐ Condition Present - There is a building served by private sewage disposal system on this property or a building without any lawful sewage disposal system. A certified inspector's report is attached which documents the condition of the private sewage disposal system and whether any modifications are required to conform to standards adopted by the Department of Natural Resources. A certified inspection report must be accompanied by this form when recording.
- ☒ Condition Present - There is a building served by private sewage disposal system on this property. Weather or other temporary physical conditions prevent the certified inspection of the private sewage disposal system from being conducted. The buyer has executed a binding acknowledgment with the county board of health to conduct a certified inspection of the private sewage disposal system at the earliest practicable time and to be responsible for any required modifications to the private sewage disposal system as identified by the certified inspection. A copy of the binding acknowledgment is attached to this form.
- ☐ Condition Present - There is a building served by private sewage disposal system on this property. The system is failing to ensure effective wastewater treatment or is otherwise improperly functioning, and the buyer has executed a binding acknowledgment with the county board of health to install a new private sewage disposal system on this property within an agreed upon time period. A copy of the binding acknowledgment is provided with this form.
- ☐ Condition Present - There is a building served by private sewage disposal system on this property. The building to which the sewage disposal system is connected will be demolished without being occupied. The buyer has executed a binding acknowledgment with the county board of health to demolish the building within an agreed upon time period. A copy of the binding acknowledgment is provided with this form. [Exemption #7]
- ☐ Condition Present - There is a building served by private sewage disposal system on this property. This property is exempt from the private sewage disposal inspection requirements pursuant to the following Exemption [Note: for exemption #7 use prior check box]:

- ☐ Condition Present - There is a building served by private sewage disposal system on this property. The private sewage disposal system has been installed within the past two years pursuant to permit number:

Review the following two directions carefully:

- A. If you selected a box stating "No Condition" for every numbered section above, **STOP HERE**. Do not submit this form. Instead, pursuant to Iowa Code section 558.69(8A), you must include the following language on the first page of the recorded deed, instrument, or other writing:

"There is no known private burial site, well, solid waste disposal site, underground storage tank, hazardous waste, or private sewage disposal system on the property as described in Iowa Code section 558.69, and therefore the transaction is exempt from the requirement to submit a groundwater hazard statement."


Please consult your realtor or legal counsel for further advice on this exemption. By law, the owner of the property is responsible for the accuracy of this statement, and the Department provides this information for statutory reference only.

- B. If you checked any box stating "Condition Present" for any of the numbered sections above, continue below. You must complete this form, including providing all required information, and you must submit this form to the county recorder's office with declaration of value.

Information required by statements checked above should be provided here or on separate sheets attached hereto:

I HEREBY DECLARE THAT I HAVE REVIEWED THE INSTRUCTIONS FOR THIS FORM AND THAT THE INFORMATION STATED ABOVE IS TRUE AND CORRECT.


Signature:



(Transferor)

Telephone No.:

319-560-6544



TIME OF TRANSFER INSPECTION TOT# 16558 SETH BROWN CERT # 13190

Site Information

Parcel Description: **400071020045000**

Address: **1720 Merriam Ct, Winterset, IA 50273**

County: **Madison**

Owner Information

Property is owned by a business: **No**

Business Name:

Owner Name: **Lu Ann Kadlec**

Email Address: **lupalmer@aol.com**

Address: **1720 Merriam Ct, Winterset, IA 50273**

Phone No: **319-560-6642**

Additional Contact Information

Name

Nancy Shrader

Email Address

nancy.shrader@kw.com

Affiliate Type

Realtor

Site related information

No Of Bedrooms: **4**

Facility Type: **Residential**

Last Occupied:

Permit issued by County: **N/A**

All plumbing fixtures enter septic system: **Yes**

Property Information Comments:

Inspection Date: **07/18/2025**

Currently Occupied: **Yes**

System Installation Date:

Permit Number:

County contacted for records: **Yes**

Primary Treatment

Tank 1

Tank Name: **Tank 1**

Tank Material: **Concrete**

No. of Compartments: **2**

Type: **Septic Tank**

Tank Corrosion Type: **Slight**

Pump Tank Chamber: **No**

Tank Size (Gal): **1500**

Liquid Level Type: **Normal**

Licensed Pumper Name: **Rogers Septic**

Date Pumped: **7/18/2025** Meets Setback to Well: **N/A** Well Type:
 Distance To Well (Ft.): Is Accessible: **Yes** Lid Intact: **Yes**
 Risers Intact: **Yes** Effluent Filter Present: **Yes** Watertight: **Yes**
 Tank/Vault Pumped: **Yes** Inlet Baffle Present: **Yes** Outlet Baffle Present: **Yes** Functioning as Designed: **Yes**
 Tank Comments:

General Primary Treatment Comments:

Distribution Type

Distribution System : **No**

General Distribution System Comments :

Secondary Treatment

Pkg Treatment Media Filter1

Media Type: Coco	Manufacturer: Premiere Tech	Model Number: Ecoflo EC7 Series
Serial Number: AAT 669	Maintenance Contract: Yes	
Maintenance Provider: Rogers Septic		
System Hydraulic Loaded: Yes	Gallons Loaded: 100	Discharge At Time of Inspection: Yes
CBOD5 Results (mg/L): 8	TSS Results (mg/L): 7	Disinfection Present: No
Disinfection Type:	Tertiary Treatment Present: No	Tertiary Treatment Type:
Meets Setback to Well: N/A	Well Type:	Distance To Well (Ft.):
GP4 Permitted:	GP4 Required:	Vent(s) Present: Yes
Media Present: Yes	Outlet Found: Yes	Sample Taken: Yes
System Located on Owner Property: Yes	Easement Present: N/A	Functioning as Designed: Yes
Comments:		

General Secondary Treatment Comments:

Narrative Report

TOT Inspection Report Overall Narrative Comments: **All wastewater goes to septic. 1500 gallon watertight concrete septic tank in working condition with slight deterioration. Accessible by inlet and outlet risers and lids to ground surface. Inlet and outlet baffles present, outlet effluent filter present.**

Plastic Premiere Tech Ecoflo Coco EC7 series, serial AAT 669, watertight and in working condition. Accessible by lid to ground surface. Foam board present. Tipping and dispersing trays present and in working condition. Coco in good condition, slight ponding present. Red/brown in color. Slight height deterioration in coco. Raked both sides and leveled out. Ponding went away. Hydraulic load tested(via house) 100 gallons. Discharge pipe located, WATER SAMPLE COLLECTED. Sample was collected prior to inspection, when first onsite. Current MA contract with Rogers.

TIME OF TRANSFER INSPECTION TOT# 16558 SETH BROWN CERT # 13190

Owner Name: Lu Ann Kadlec


Address: 1720 Merriam Ct , Winterset , IA 50273

County: Madison

Inspection Date: 07/18/2025

Submitted Date: 7/29/2025

This page certifies a Time of Transfer inspection was conducted and submitted for the property listed above in accordance with Subrule 567 IAC 69.2(8).

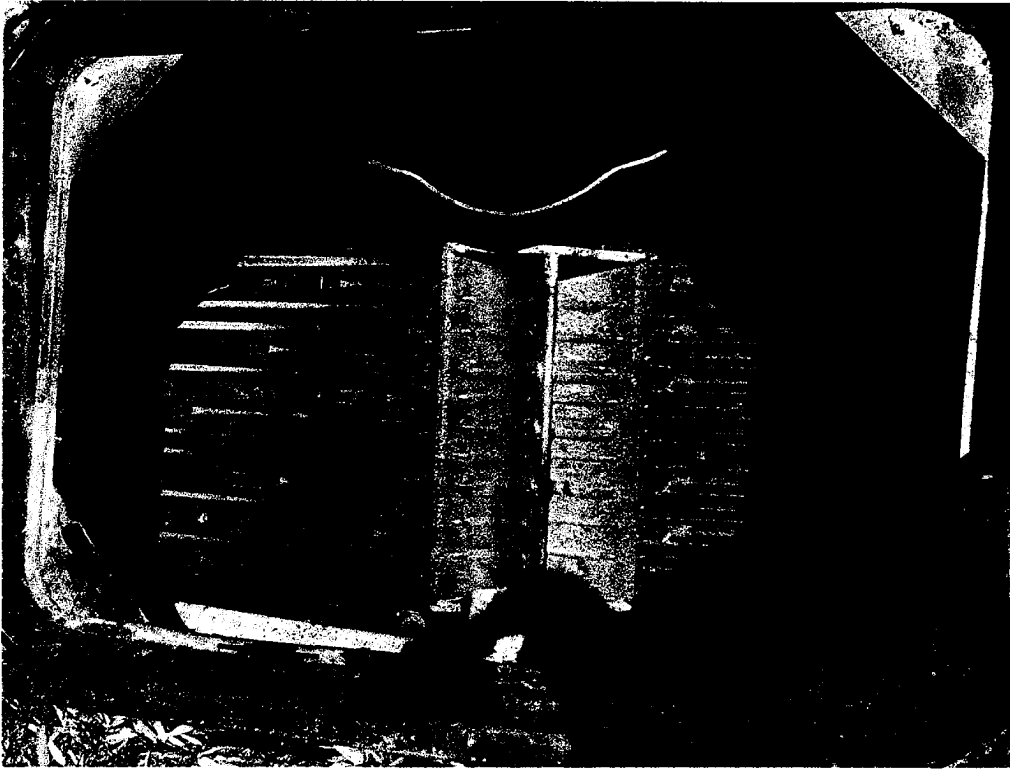



Numéro de série
Serial number

Fabriqué au Canada
Made in Canada

AAT 669

 PREMIER TECH

Ecoflo® Coco Filter 3.4

Daily Flow

600 US gal (*)
600 US gal (*)
2 200 L (*)
500 US gal (**)
450 US gal (***)
1 700 L (***)

Number of Bedrooms

4
5
6
3
3
3

State / Province

AZ, CA, IA, IL, NJ
TX
EC
VA
MN, NY, OH, PA, VT
AB

(*) Ecoflo® Coco Filter EC7 Model Series
12.1 US gal / ft² · d
790 L / m² · d

(**) Ecoflo® Coco Filter EC6 Model Series
14.1 US gal / ft² · d
675 L / m² · d

(***) Ecoflo® Coco Filter EC5 Model Series
12.2 US gal / ft² · d
500 L / m² · d

Patent(s) granted

CA2499632, US7,697,769, ES 2695173
EP1539325 (OE 110)

Notice(s) issued

2010/07/14

Reference(s)

1. 1689

patent/trading premiertechn.com



 PREMIER TECH

Madison County
Office of Zoning and
Environmental Health

***Authorization to Construct a
Private On-site Wastewater
Treatment System (POWTS)***

112 N. John Wayne Drive
P.O. Box 152
Winterset, IA 50273-0152
Telephone: (515) 462-2636

Permit Number: 033-16 Revised

Date Issued: 11/14/16

Issued to: Tim & Lu Ann Kadlec
Address: ~~3036 133rd Cr.~~
Van Meter, IA 50261

1720 Merriam Ct.

Legal Description: Lot 4 7.68A Hillcrest Sub. PID# 400071020040000 Sec 10 T76N R27W Union Twp.

POWTS Components Specifications: 1500gal. Septic Tank & Eco-Flow Coco Filter

General Conditions:

1. System must be constructed in conformance with attached system layout, profiles, and cross-sections.
2. Structures must be constructed in conformance with 567 IAC Chapter 69 and the Madison County Environmental Health Regulations.
3. Permit shall be null and void if system is not constructed within one year of permit issuance. The Environmental Health Officer must approve any request for extension of permit.
4. The Environmental Health Officer must approve any design modifications to the permitted system prior to construction.
5. Once constructed, all system components must be uncovered for inspection and the system must be approved before it can be put into operation. Notice for inspection must be received with 24 hours in advance (8 a.m. through 4:30 p.m., Monday - Friday). If weather necessitates the need to cover the system components, then the system owner or contractor must notify and follow the procedures given by the Environmental Health Officer.

Special Conditions: All Testing, Fees & Contracts shall be in accordance with County & State rules.



**Environmental Health Officer
Madison County
Office of Zoning and Environmental Health**

Madison County
Office of Zoning and
Environmental Health

***Authorization to Construct a
Private On-site Wastewater
Treatment System (POWTS)***

112 N. John Wayne Drive
P.O. Box 152
Winterset, IA 50273-0152
Telephone: (515) 462-2636

Permit Number: 033-16

Date Issued: 06-08-2016

Issued to: Tim & Lu Ann Kadlec
Address: 3036 133rd Ct.
Van Meter, IA 50261

*Revised
11-14-16*

Legal Description: Lot 4 7.68A Hillcrest Sub. PID# 400071020040000
Sec 10 T76N R27W Union TWP

POWTS Components Specifications 1500 gal. septic tank & 960 Sq. Ft. Sand Filter

General Conditions:

1. System must be constructed in conformance with attached system layout, profiles, and cross-sections.
2. Structures must be constructed in conformance with 567 IAC Chapter 69 and the Madison County Environmental Health Regulations.
3. Permit shall be null and void if system is not constructed within one year of permit issuance. The Environmental Health Officer must approve any request for extension of permit.
4. The Environmental Health Officer must approve any design modifications to the permitted system prior to construction.
5. Once constructed, all system components must be uncovered for inspection and the system must be approved before it can be put into operation. Notice for inspection must be received with 24 hours in advance (8 a.m. through 4:30 p.m., Monday - Friday). If weather necessitates the need to cover the system components, then the system owner or contractor must notify and follow the procedures given by the Environmental Health Officer.

Special Conditions: Must be built according to county approved diagram.

Jina Burk

**Environmental Health Officer Assistant
Madison County
Office of Zoning and Environmental Health**

Madison County
Office of
Zoning & Environmental Health

Application to Construct
Private Sewage Disposal System (PSDS)

112 N. John Wayne Dr.
P O Box 152
Winterset, IA 50273
Telephone (515) 462-2636

Revised 11/14/16 Office Use Only					Temp E911:	
Tracking No. 033-16	Date Received 6/8/16	Fee Paid 2601.00	Check # 4576	Date Issued 6/8/16	Section/Township 16-Union	

Application will not be accepted until site and soil analysis/percolation information have been received and fee has been paid. For systems requiring an NPDES General Permit #4 (surface discharge), its application must be submitted to this office along with appropriate forms for recording before a permit will be issued.

Please Print All Information.

1. Owner Information (Applicant) First Name: Timothy Last Name: Kadlec Address: 3036 133rd Ct City: Van Meter State: IA Zip: 50261 Phone Number (area code): 319-560-6642 Cell Phone: 319-560-6544			2. Installation Contractor Information First Name: Chris Last Name: Hansen H+H Plumbing Address: 32411 170th St. City: Granger State: IA Zip: 50109 Phone Number (area code): 515-277-5755 Cell Phone: 515-201-8004		
3. System Requirement Information IAC CHAPTER 69 DOUBLE COMPARTMENT TANK REQUIRED Minimum Tank Size Required 1-3 Bedroom: 1250 4 Bedroom: 1500 5 Bedroom: 1750 6 Bedroom: 2000			4. Site and Soil Evaluator (Percolation Test/Soils Analysis) PERCOLATION/SOILS ANALYSIS MUST BE COMPLETED AND APPROVED PRIOR TO THE ISSUANCE OF PERMIT Date test taken: 6/20/15 Test taken by: CMT Passed: Yes Failed: _____ Percolation Rate: 35 min/inch Soils Loading Rate: 0.375 qpsi/dav		
5. Type of Submittal <input checked="" type="checkbox"/> New House <input type="checkbox"/> Existing House <input type="checkbox"/> Repair, Tank <input type="checkbox"/> Repair, Treatment Area <input type="checkbox"/> System Replacement Previous Permit #:		6. Address Information Merriam Court Winterset, IA 50273 911 Address or nearest road: Legal Description: P10 # 400071020040000 Lot 4 7.68A Hillcrestsub Sec 10 10-76-27			
7. Type of Building (Completed by Owner) Building Square ft.: 3824 Number of Bedrooms: 4 Number of Bathrooms: 3 1/2 Non-Residential uses: Other buildings served by this system: Any other circumstances which may affect water usage: Water softeners must be routed to a brine pit independent of septic system.					
Your contractor or system designer should complete the remaining portion of this application.					
8. Tanks					
Septic Tank	Type: Concrete	Size: 1500	Manufacturer: Lister		
Pump Tank	Type:	Size:	Manufacturer:		
Additional Tank	Type:	Size:	Manufacturer:		
9. Secondary Treatment Area					
Laterals	Type:	Length of each:	Total number:	Maximum trench Depth:	
Sand Filter	Square ft.: 960	Length: 64 40	Width: 24 24		
Peat System	Model:	Manufacturer:			
Other	Description: ECO Flow	Coco Filter	600		
I hereby attest the truth and accuracy of all facts and information presented on this application. Request for inspection of the system must be made 24 hours in advance. Water at the site to test the distribution box must be available. Discharging systems must be covered by a maintenance agreement, which shall be recorded in the Madison County Recorders Office. Discharging systems also require periodic testing as set forth in IAC Chapter 69 and Madison County Environmental Health Regulations.				It is unlawful to start construction, reconstruction, or repair of any PSDS prior to issuance of a PSDS permit by the Environmental Health Officer.	
Applicant Signature: <i>Chad Kadlec</i>			Date: 6/6/16		



SEPTIC SYSTEM

SOIL ANALYSIS & DESIGN

MERRIAM COURT - WINTERSET

LOT 4 7.68A HILLCRESTSUB SEC 10

MADISON COUNTY

REVISED


Performed For:

Mr. Tim Kadlec
3036 133rd Court
Van Meter, IA 50261

Conducted By:

Construction Materials Testing, Inc.
1610 E. Madison Ave
Des Moines, IA 50313

November 14, 2016

	I hereby certify that this engineering document was prepared by me or under my direct personal supervision and that I am a duly licensed Professional Engineer under the laws of the State of Iowa.
	<p><i>Sybil K. Ferrier</i> 11-14-16 Sybil K. Ferrer, P.E. Date License No. 20479 My License renewal date is December 31, 2016 Pages or sheets covered by this seal: All Pages.</p>




November 14, 2016

Mr. Tim Kadlec
3036 133rd Court
Van Meter, Iowa 50261

Re: Septic Design
Merriam Court - Winterset
Madison County
LT 4.7 7.68A Hillcrest Sub Sec 10
REVISED

Dear Mr. Kadlec,

The following is a report designed to determine potential septic field locations and determine soil classifications for your project in Madison County, Iowa.

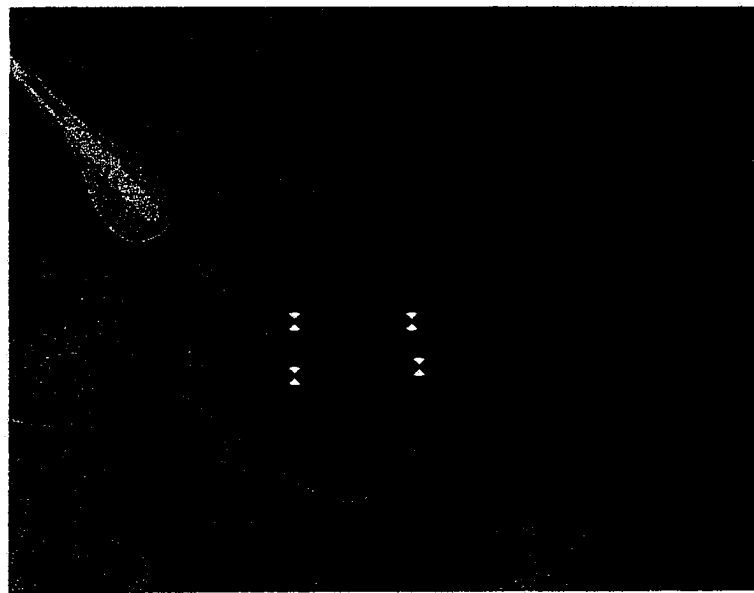

↑
North
Not to Scale


Photo courtesy of Google Earth

- B-1 Approximately 65 ft south of the southwest corner of the house stake
- B-2 Approximately 80 ft east of B-1
- B-3 Approximately 30 ft south of B-2
- B-4 Approximately 40 ft south of B-1

1610 East Madison Ave. • Des Moines, Iowa 50313
(515) 263-0794 • Fax (515) 263-0851
www.cmt-iowa.com

Construction CMaterials Testing

The test results indicate the site will require an alternate system such as a peat or sand filter system. A layer of moderately expansive clay begins immediately below the topsoil causing a restrictive layer that prohibits a standard lateral system. This system will be a new system. General locations were provided by measurement. This report should be forwarded to Madison officials in order to expedite the construction of the septic system.

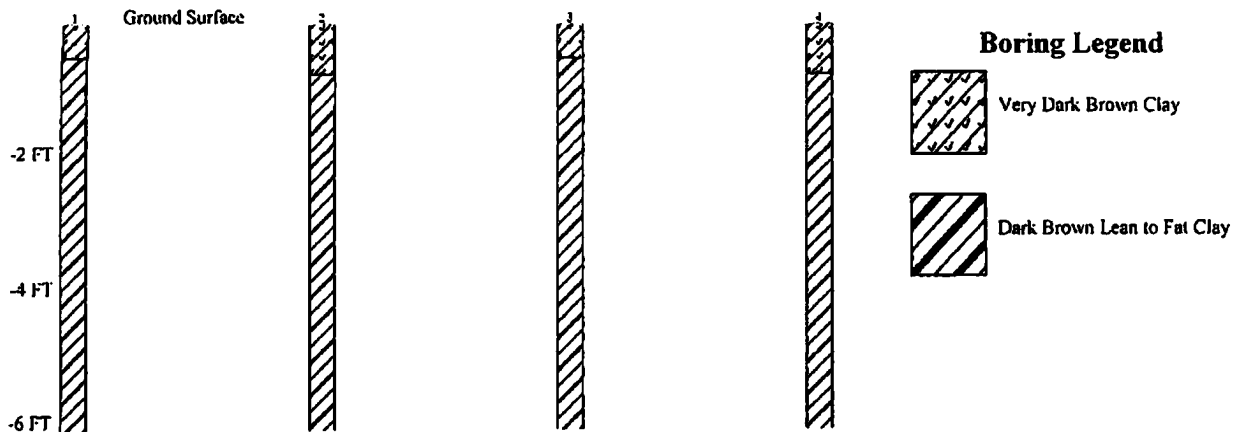

Bedrooms: 4

Design Flow: 600 GPD

Structure: New

Soil Loading Rate: 0.375 gpsf/day

Water Table At: (No Free Water at 6 ft)

Percolation Rate: 35 min/inch

Soil Structure: Moderate



Notes and Recommendations:

1 This site consists of approximately 0.5 ft of topsoil underlain by dark brown lean to fat clay. The natural slope of the land is to the south at a rate of 5 ft per 100 feet. At the time of our study, the moisture content of the clay was moderate. We are recommending a peat filter system using gravity flow. A minimum of a 1,500 gallon tank is recommended for this property. The area south of the home will provide gravity drainage and enough area for the system. Maintain proper distances from bodies of water, such as the pond, to the east of the homestead.

2 Proper maintenance of the septic tank and filter system will extend the useful life span of the system. Any changes to the information used to produce this report will nullify its recommendations and information. Changes will require written documentation from our office to be incorporated at this location. In order to comply with county regulations, testing for CBOD, TSS and E. coli may be required. These requirements should be verified through Madison County.

3 Please ensure that the layout proposed by the septic contractor meets any and all county requirements. The numbers regarding design flow, surface area and soil loading rate are based on tests taken on-site as well as conducted at our laboratory. Prior to the installation of the system, the septic contractor shall provide information to the county regarding equipment type and size. A licensed septic contractor is required by Madison County.


Please feel free to call our office, should you have any questions or if we may be of any further assistance.

Sincerely,



Sybil K. Ferrier, P.E.
Principal Engineer

sp/sf



Doug Clement
President/CEO

RLS1042
2016 061

Assessor Real Estate

INQUIRY

PID 400071020040000 00 Tax Dist 400 000 Class A
Map# 000000710200015 GIS#

Property 9997593 DED KADLEC, TIMOTHY L. &
Ownership 3036 133RD CT
 VAN METER IA 50273

*

Location 000000 Street City

Recorded DED 2015 2911 10/05/2015 2911 2015/09/30
Documents DED 2013 1635 6/06/2013 1635 2013/05/31 +
Misc S F 10 Exempt Code Vin
Sec-Twp-Rng 010 076 027 Cty-Adn-Blk 00010 Title

Legal Desc LT 4 7.68A HILLCREST SUB SEC 10

Applications Typ 1 AGL Ovr Amt Typ 2 Ovr Amt
 Typ 3 Ovr Amt Typ 4 Ovr Amt

F3=Exit F10=Ownership F12=Prev F13=Rec Doc F15=Legal F16=Notes
F17=IE F18=TaxHist F19=Applc F22=ViewImage F23=Indexing

Hansen's M & M Services

202 North Division Street
Audubon, Iowa 50025

Telephone or Fax Number: 712-563-2030


Email lynhansen@iowatelecom.net

June 8, 2016


Ref: Madison County: Address Issued - 1720 Merriam Ct

Madison County Map Entries													
1,2	x		County	2147	6/8/2016	Timothy L Kadlec & LuAnn Palmer Kadlec	1720 Merriam Ct	Winterset	UNION	10	50273	507	GPS provided 41.399403 - 93.938612 Hillcrest Sub Lot 4

Insert 1: 1720 Merriam Ct

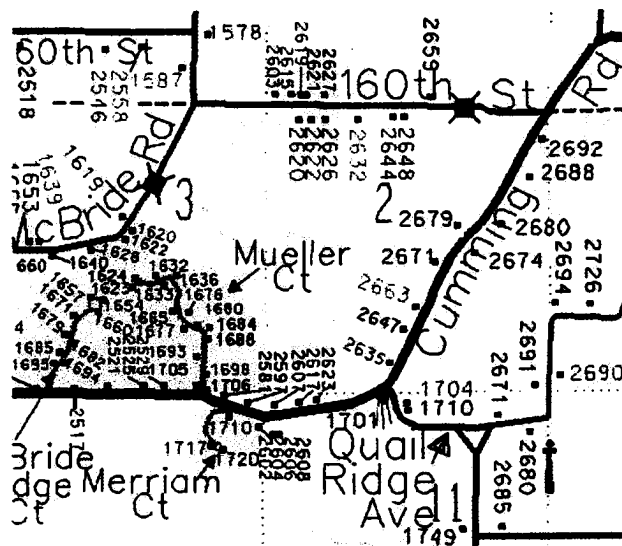

Insert 2:

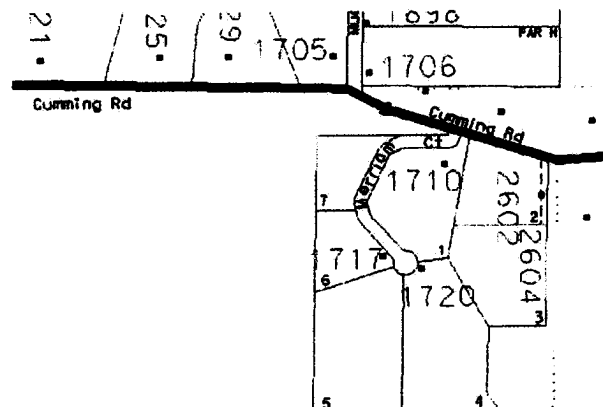

Permit No 033-16 Name: **Kadlec** 911 Sign Locate ☐

Date of Inspection: 11/15/16 Inspected by: **Elton Root**

Contractor: **H&H Services**

Dwelling under construction or moved in Yes ☒ No ☐

Setbacks

Meets required setbacks.

- | | | |
|---|---|-----------------------------|
| • Rural Water | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> |
| • Private wells/heat pump wells/suction water lines/lakes | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> |
| • Outside required 50-foot setback for tank | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> |
| • Outside required 100-foot setback for laterals | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> |
| • Streams/ponds (25-25 ft)-ditches (10-10 ft) | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> |
| • Indications of water lines under pressure | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> |

Comments:

Building Sewer

- | | | |
|---|---|-----------------------------|
| • Clean outs – one right outside of house | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> |
| • location of cleanout inside house and set requirement | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> |
| • Pipe is SCH 40 and has a 4-inch diameter. | Yes <input type="checkbox"/> | No <input type="checkbox"/> |
| • Grade – has adequate fall. | Yes <input type="checkbox"/> | No <input type="checkbox"/> |

Comments:

Tank


- | | | |
|--|---|---|
| • Septic/Pump Tank Size & Manufacturer Lister 1500 | Concrete <input checked="" type="checkbox"/> | Plastic <input type="checkbox"/> |
| • Pump Tank Size & Manufacturer | Concrete <input type="checkbox"/> | Plastic <input type="checkbox"/> |
| • Septic compartments meet the specs for capacity. | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> |
| • Baffle | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> |
| • Inlet/Outlet tees are ok. | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> |
| • Effluent filter in the outlet. | Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> | Manuf. Poly Lock 4" Gray |
| • Tank depth 12 inches | | |
| • Risers | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> |
| • Lids above grade screwed on | Yes <input type="checkbox"/> | No <input type="checkbox"/> Will be <input checked="" type="checkbox"/> |

Comments:

Secondary Treatment

- Eco Flow Coco Filter
- AAT 669

Comments:

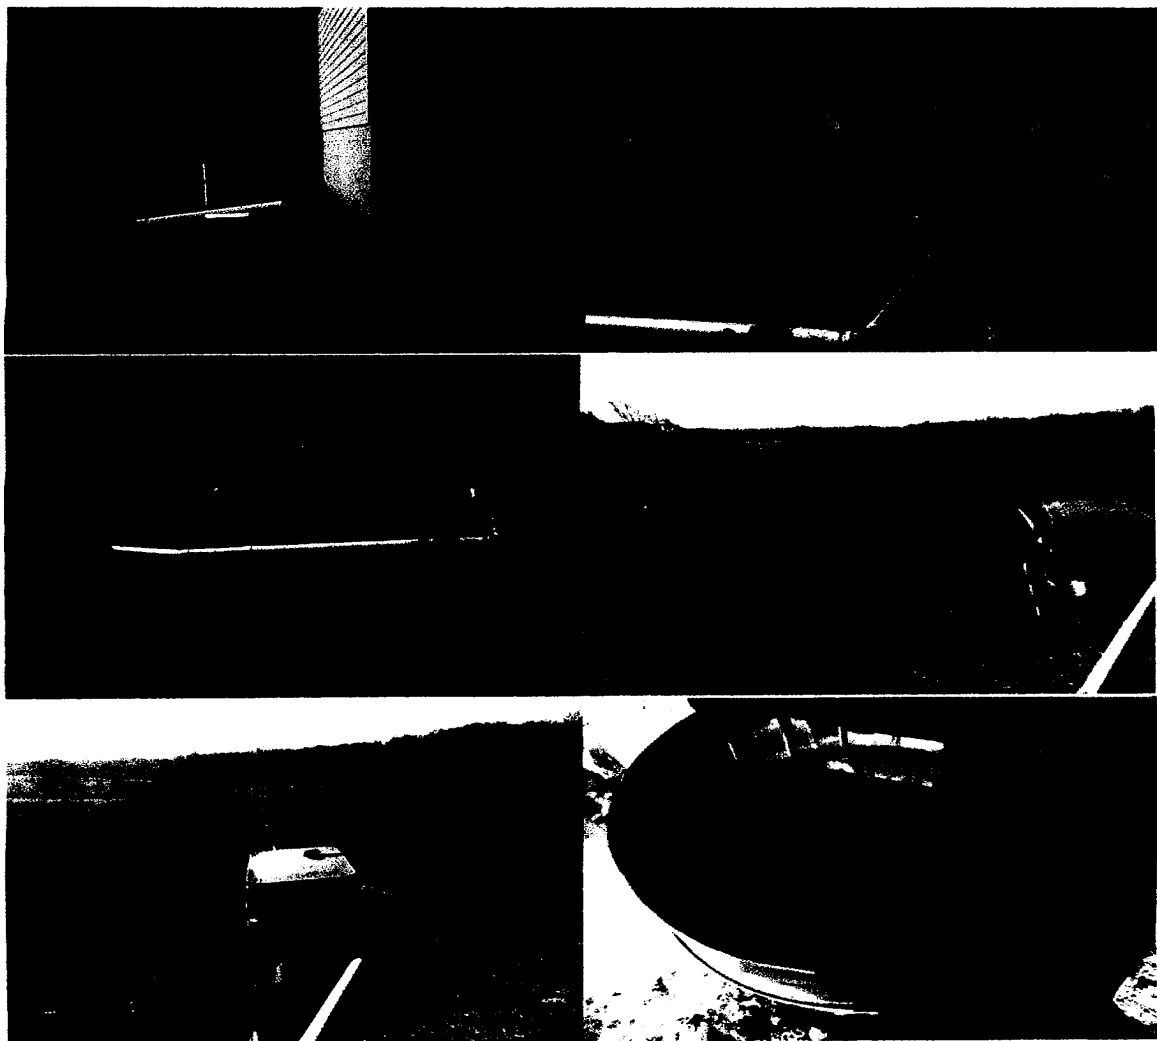


AAT 660
AAT 660
AAT 660
AAT 660

AZ CA IL IN NY NJ PA VA WI

AAT 660
AAT 660

AAT 660
AAT 660

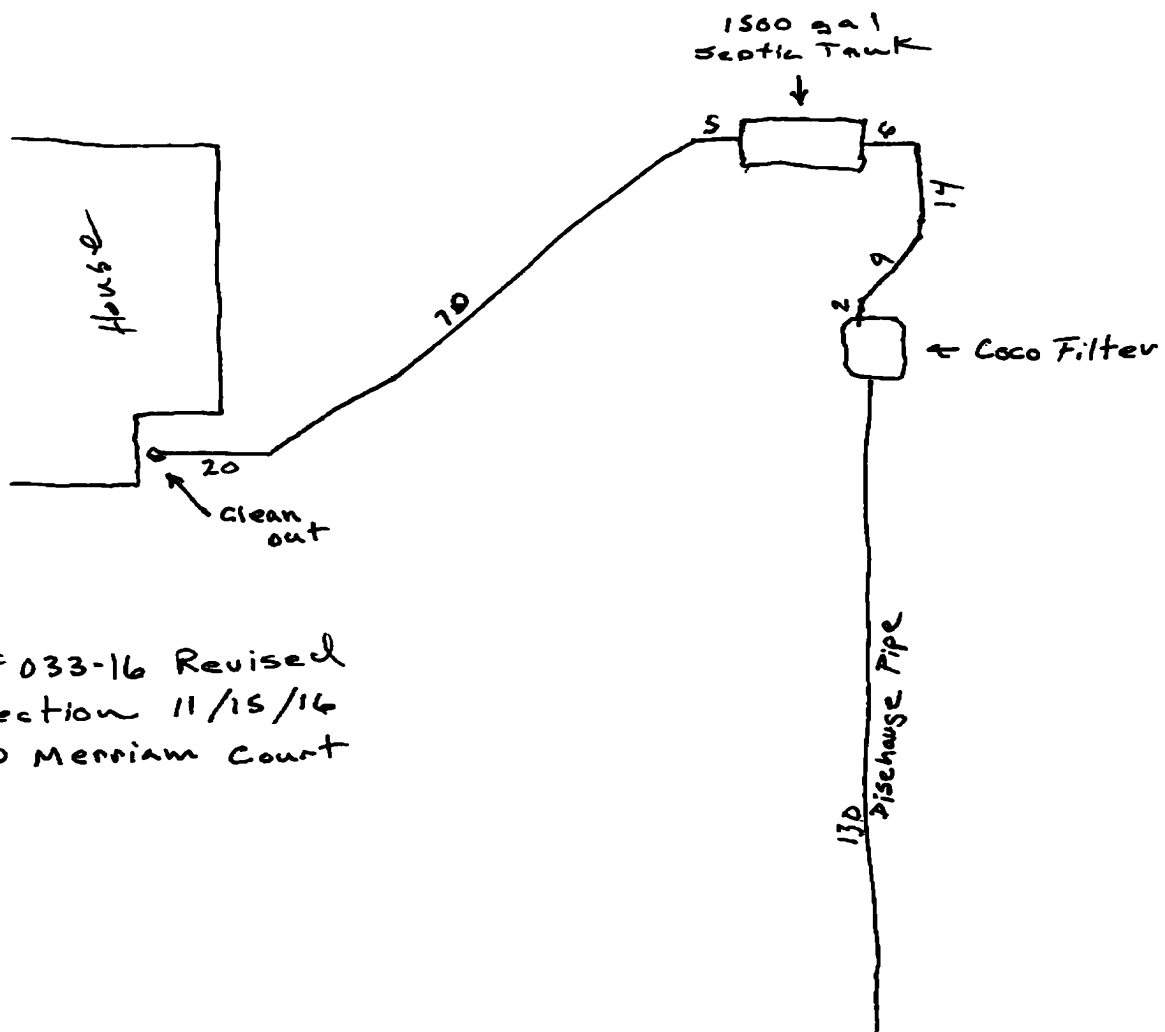

Permit # 033-16 Revised
Inspection 11/15/16
1720 Merriam Court

Parameters

SM 6210 B-2016						
CBOD (5 day)	<8	8	mg/L	07/22/25 1358	07/22/25 1626	MND
USGS 1-3766-46						
Total Suspended Solids (TSS)	7	1	mg/L	07/22/25 1536	07/23/25 0903	LAW